


No XREFs
i: \Key_Std\SAS\Details\dwg\Sasd-PUB-20s.dwg

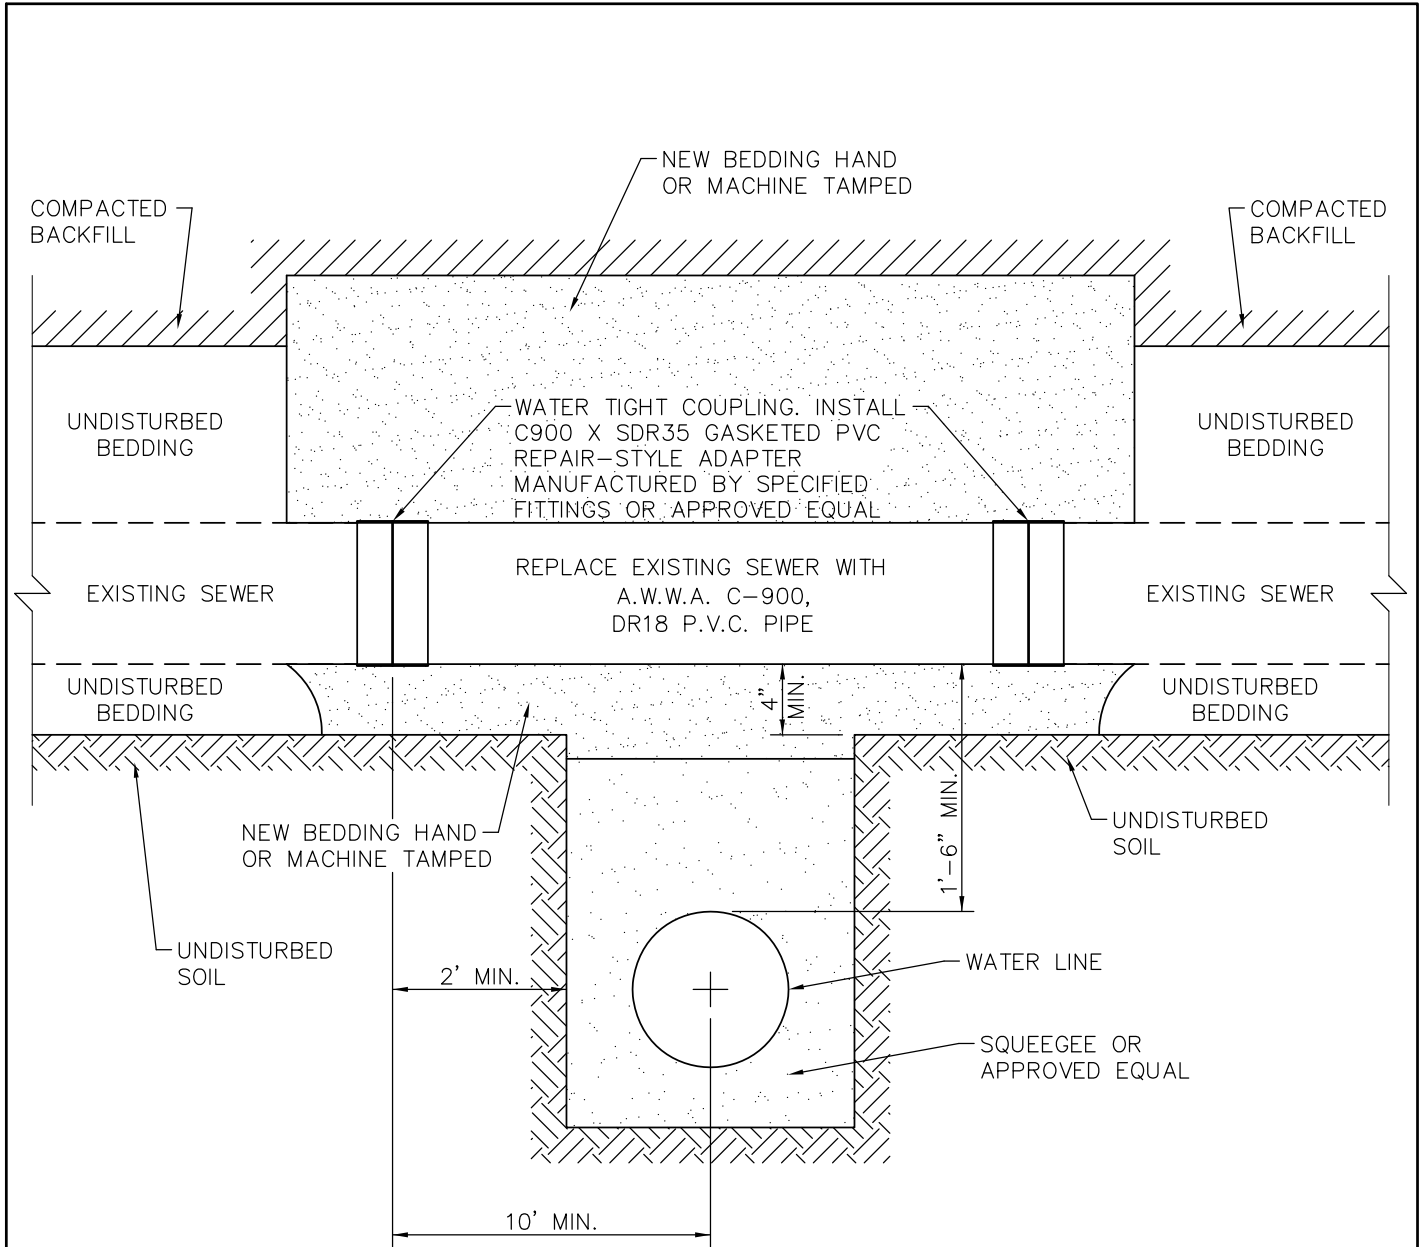

NOTES:

1. THIS STANDARD APPLIES ONLY FOR NON-PRESSURIZED SANITARY SERVICE TAPS AND SANITARY SEWERS EIGHT (8) INCH AND SMALLER. SANITARY SEWERS MAY NOT BE CUT WITHOUT THE EXPRESSED CONSENT OF THE DISTRICT. A DISTRICT REPRESENTATIVE WILL BE ON SITE DURING CONSTRUCTION.
2. C900 PVC PIPE USED TO REPLACE SECTION OF SANITARY SEWER SHALL BE PLACED IN A TRENCH, BEDDED, BACKFILLED AND COMPACTED IN ACCORDANCE WITH THE DISTRICT SPECIFICATIONS.

Kennedy/Jenks Consultants
Engineers & Scientists
143 Union Boulevard
Suite 600
Lakewood, CO 80228
303 985 3636 TEL.
303 985 3800 FAX



**SEWER CROSSING
DETAIL**

DRAWING NO.: SASD-PUB-20S DATE: 10/11