


No. XREFs
I: \Key_Std\SAS\Details\dwg\Sasd-PUB-6s.dwg

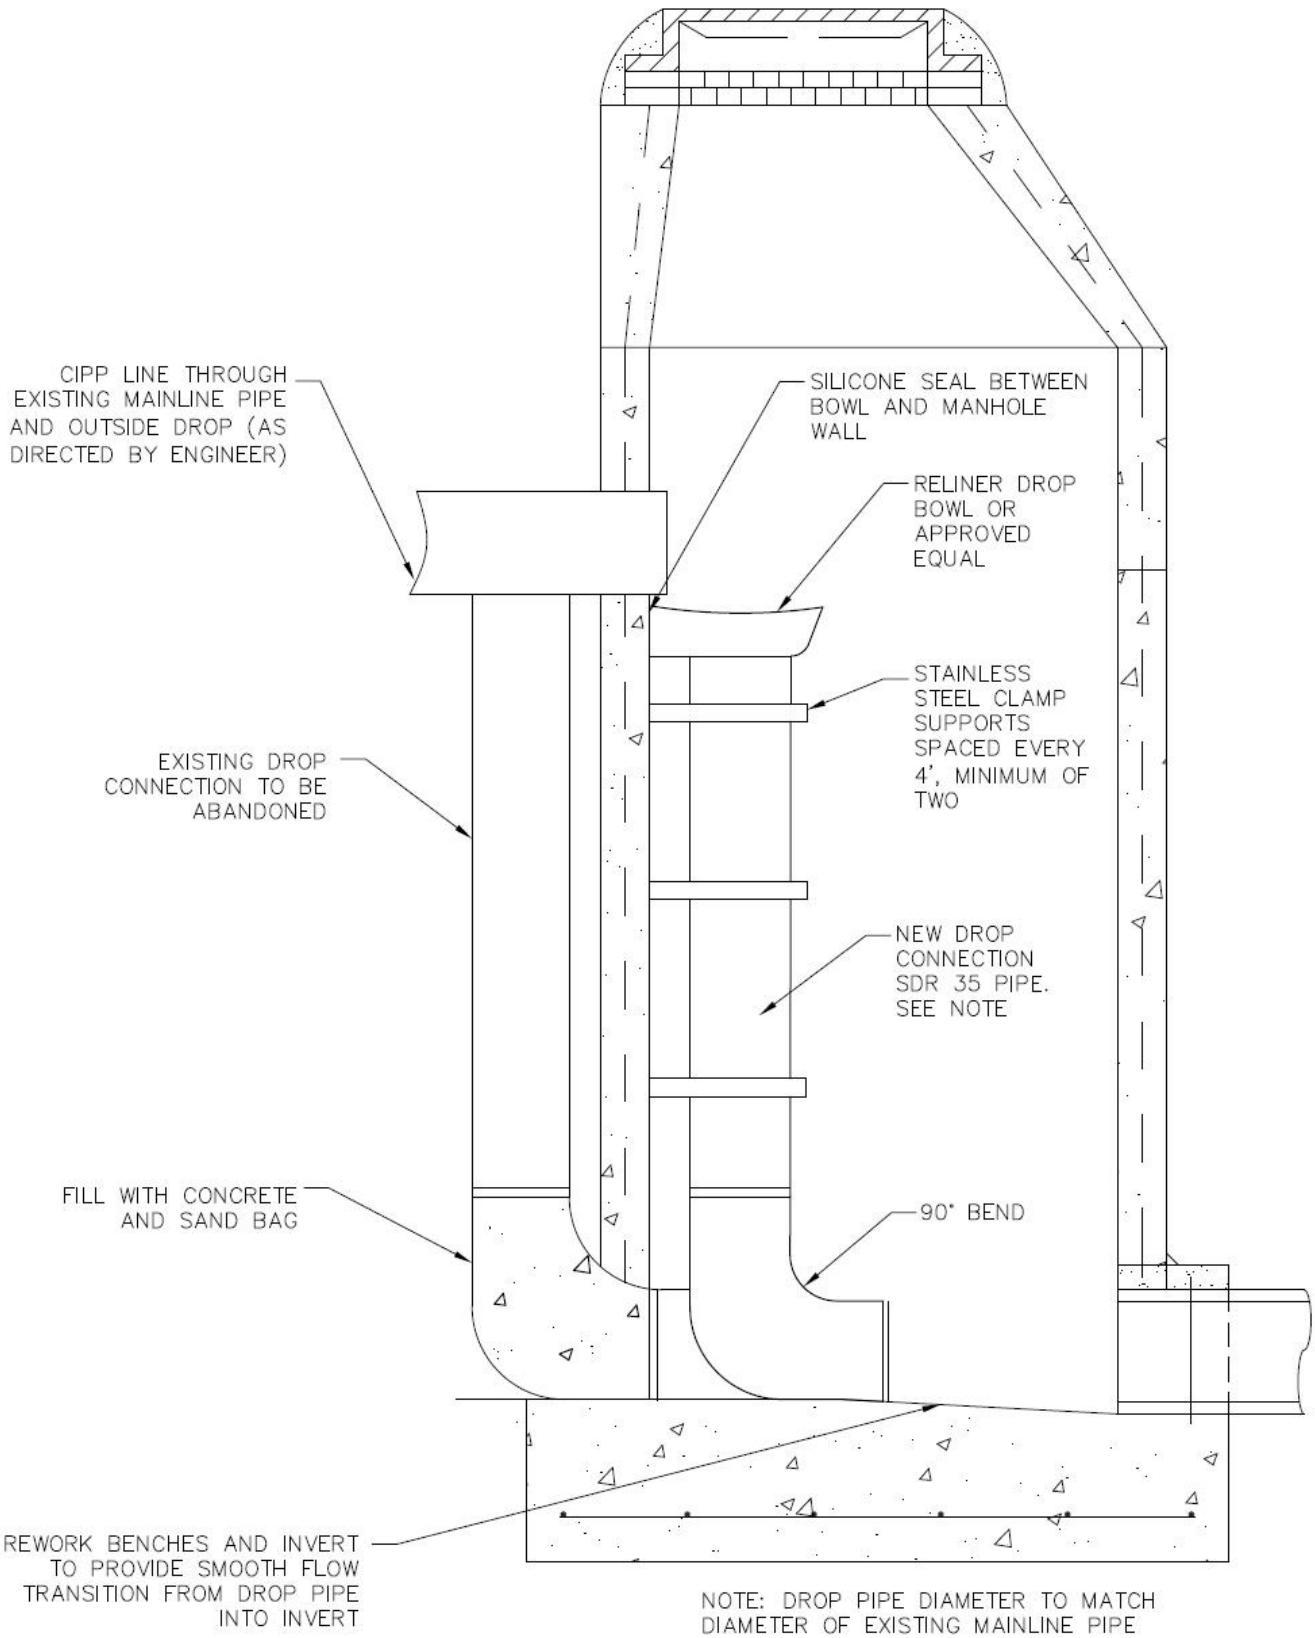

CIPP LINE THROUGH EXISTING MAINLINE PIPE AND OUTSIDE DROP (AS DIRECTED BY ENGINEER)

SILICONE SEAL BETWEEN BOWL AND MANHOLE WALL

RELINER DROP BOWL OR APPROVED EQUAL

STAINLESS STEEL CLAMP SUPPORTS SPACED EVERY 4", MINIMUM OF TWO

EXISTING DROP CONNECTION TO BE ABANDONED

NEW DROP CONNECTION SDR 35 PIPE. SEE NOTE

FILL WITH CONCRETE AND SAND BAG

90° BEND

REWORK BENCHES AND INVERT TO PROVIDE SMOOTH FLOW TRANSITION FROM DROP PIPE INTO INVERT

NOTE: DROP PIPE DIAMETER TO MATCH DIAMETER OF EXISTING MAINLINE PIPE

Kennedy/Jenks Consultants
Engineers & Scientists
143 Union Boulevard
Suite 500
Lakewood, CO 80228
303 985 3636 TEL.
303 985 3800 FAX



OUTSIDE DROP MANHOLE REPLACEMENT WITH INSIDE DROP

DRAWING NO.: SASD-PUB-6S DATE: 12/2013